

National Guard Products Inc.
1-800-647-7874

9550
Self Adhesive
Fire & Smoke Seal



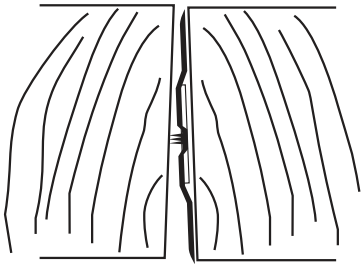

Made in USA

BHMA CERTIFIED

1/8" clearance required between doors or between door and frame.

UL Tested and Classified for Fire and Smoke Doors.
* Seals against smoke, fire, air and weather.
* Excellent compression; door latches easily.

Installation Instructions

1. The surface temperature of the frame must be above 50°F for adhesive to bond.
2. Clean frame with clean wipe provided remove dust, oil, grease and dirt. Wax coated or high gloss painted surfaces may require roughening with a scotch brite pad or sandpaper so adhesive will bond properly.
3. Measure and pre-cut pieces to fit where seal is to be mounted.
4. Remove protective backing 1 to 2 feet at a time.
5. Position on frame opposite edge of door or at meeting edge as illustrated above.
6. Adhere by pressing firmly (approx 15 lbs. pressure required) straight down along entire length of gasketing. Do not remove and relocate.
7. Make sure the seal does not impede proper closing and latching of the door.

UL CERTIFIED SAFETY US·CA 73NN

POSITIVE PRESSURE TESTED GASKETING MATERIALS
FOR FIRE DOORS
FOR APPLICATION TO HOLLOW-METAL-TYPE FIRE DOORS
RATED UP TO 3 HOURS AND WOOD-TYPE FIRE DOORS
RATED UP TO 1-1/2 HOURS.
CATEGORY G, H

Smoke & Draft Control Gasketing (Category H) tested to UL 1784; meets requirements of NFPA 105, IBC for use on 'S' label doors.

NGP-EDGE® Sealing System (Category G) for perimeter and/or meeting edge use on category B wood type fire doors rated up to 90 minutes, single swing up to 4'0" x 9'0" and pairs up to 8'0" x 9'0".

STORAGE AND SHELF LIFE
The adhesive on this seal has a shelf life of one year stored at 75°F and 50% relative humidity or less